



# NOTES


1. The culvert ends shall be beveled to match the embankment or ditch slope, without exceeding the limits shown on this plan.
2. Field cut of culvert ends is permitted, when approved by the Engineer. All field cut culvert pipe shall be treated with treatment as shown in the Standard Specifications or General Special Provisions.

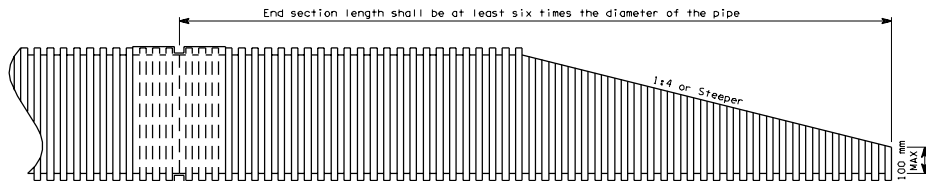

**THERMOPLASTIC PIPE**

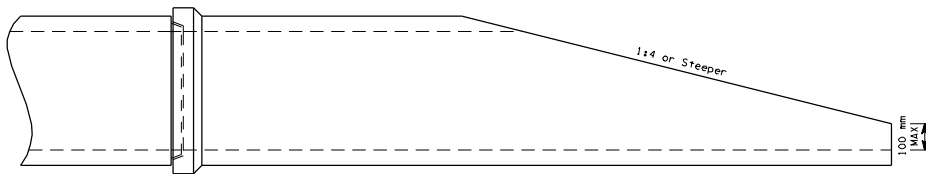

**CONCRETE PIPE**

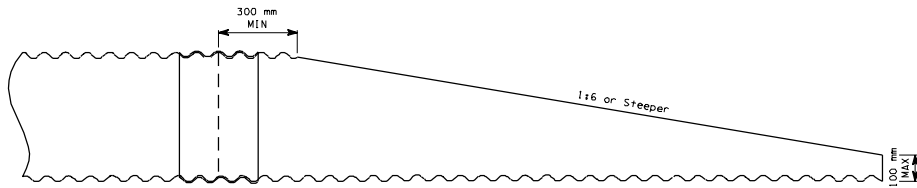

**METAL PIPE**

ALL DIMENSIONS ARE IN MILLIMETERS  
UNLESS OTHERWISE NOTED

## BEVELED END SECTIONS